

# E528/X47 4G Line Voltage Wiring

CONFIDENTIAL

---

## Disclaimer

This document contains information that is the proprietary and confidential property of INNCOM by Honeywell. By acceptance hereof, each recipient agrees to use the information contained herein only for the purpose anticipated by INNCOM by Honeywell, and not to disclose to others, copy or reproduce, any part hereof without the written consent of INNCOM by Honeywell. The recipient agrees to return this document to INNCOM by Honeywell immediately upon request.

- **DISCONNECT POWER BEFORE BEGINNING INSTALLATION. ELECTRICAL HAZARD:** Can cause electrical shock or equipment damage.
- **Must be installed by a trained , experienced technician.**
- **See device specific product guides for load specifications.**

---

## Table of Contents

1. WIRING GUIDE LINE VOLTAGE POWER SUPPLY ("B1" OPTION).....	2
2. THERMOSTAT WIRE CONNECTIONS: .....	3
3. SYSTEM SPECIFIC WIRING GUIDES .....	4
4. LOW VOLTAGE WIRING .....	6
5. FIELD SIDE WIRING .....	7
6. DOCUMENT INFORMATION .....	8



## 2. Thermostat wire connections:

### HVAC INTERFACE

Connection	Color	Function
FC1	Green	EARTH GROUND
FC2	Black	LINE
FC3	White	NEUTRAL
FC4	Yellow	HIGH FAN RELAY
FC5	Orange	MED FAN RELAY/ HEAT RELAY(STAGE 2)
FC6	Red	COMPRESSOR CONTACTOR
FC7	Brown	HEAT RELAY(STAGE 1)/ REVERSING VALVE
FC8	Grey	VALVE POWER
FC9	Violet	FAN POWER
FC10	Blue	LOW FAN RELAY

### LOW VOLTAGE INTERFACE


Connection	Color	Function
FC11	Brown	DC GROUND
FC12	Red	DC OUT
FC13	Orange	S5 BUS
FC14	Yellow	INPUT 1
FC15	Green	INPUT 2

### FIELD SIDE INTERFACE


Connection	Color	Function
FC16	Orange	10K NTC (REMOTE THERMISTOR INPUT)
FC17	Red	GROUND
FC18	Brown	NO CONNECTION
FC19	Orange	10K NTC (REMOTE THERMISTOR INPUT)
FC20	Red	GROUND
FC21	Brown	NO CONNECTION
FC22	Orange	ANALOG OUTPUT-2
FC23	Red	ANALOG OUTPUT-1
FC24	Brown	GROUND

### 3. System Specific Wiring Guides

Generic Single Stage Heat/Cool

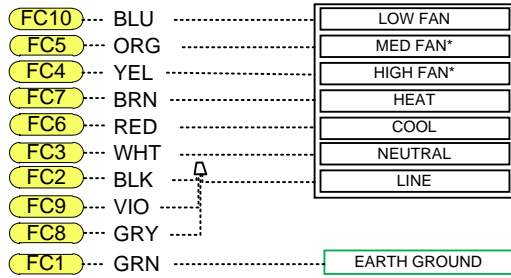


Unused Fan Outputs




\*Unused fan outputs in any HVAC Type shall be tied to FC10


Heat Pump North (HpO)-Single Stage Heat

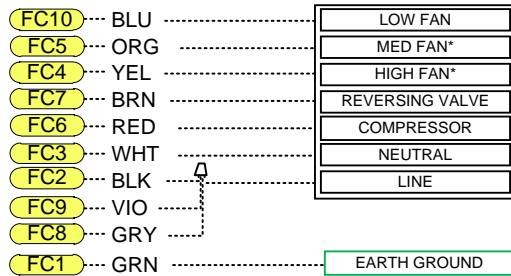


Heat Pump North (HpO)-Two Stages Heat

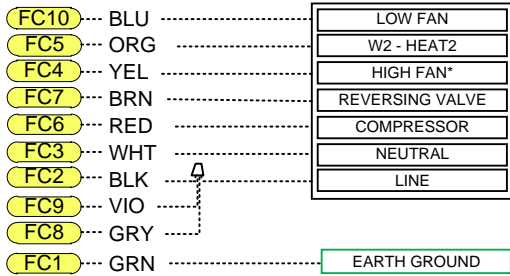


Heat Pump South (HpB)-Single Stage Heat

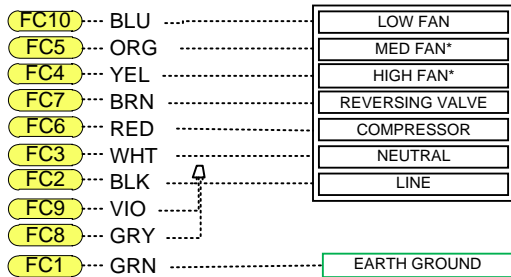


Heat Pump South (HpB)-Two Stages Heat

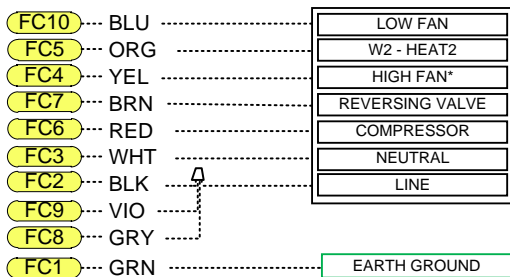


2 Pipe Change-Over

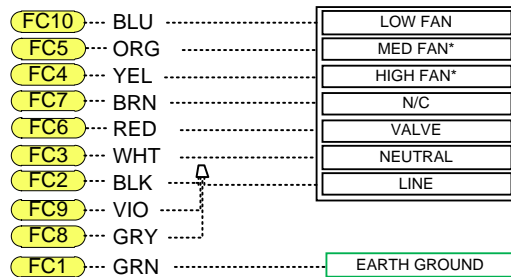


2 Pipe Change-Over with Back-up Electric Heat

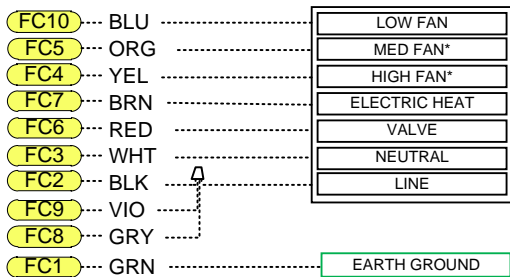

Cool Only System

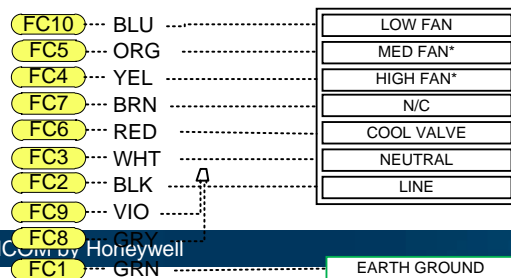

Heat Only System

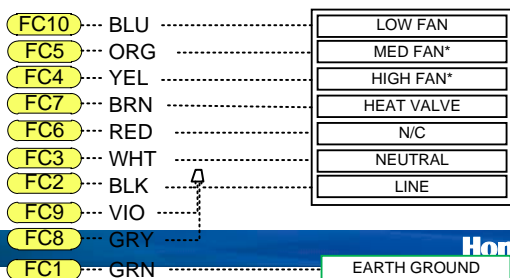




## 4. Low Voltage Wiring


Door Contact Only

Closed Door=Closed Contact

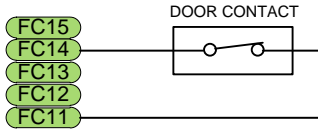


Window Contact Only


Closed Window=Closed Contact




Door & Window Contact




Window Contact & PIR Sensor

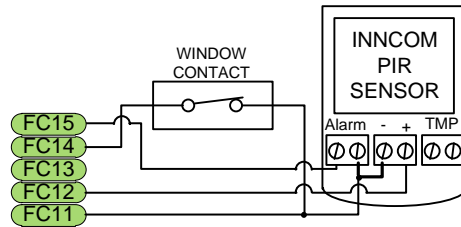


Door Contact & PIR Sensor

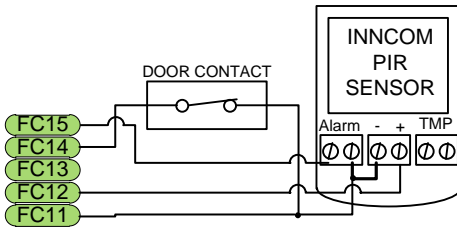


PIR Sensor Only

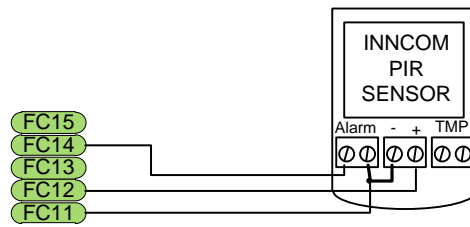


If Multiple Window Contacts in Series

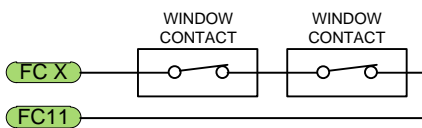

If Multiple PIR Sensors in Series

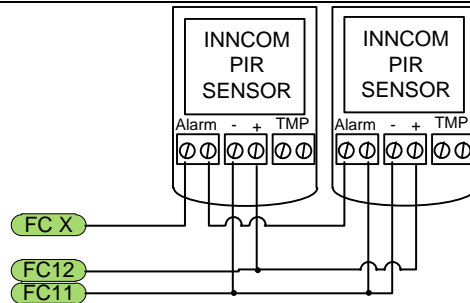


S5 Bus




S5 BUS:  
TO OTHER S5  
ROOM DEVICES

## 5. Field Side Wiring


Variable Fan connection using ANG OUT-1

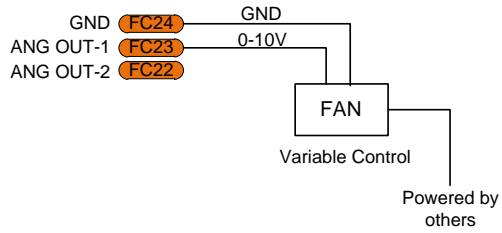


Variable Fan connection using ANG OUT-2

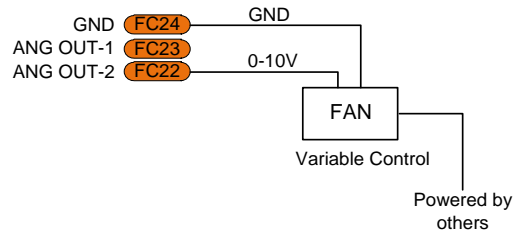


Heat/Cool Valve connection using ANG OUT-1

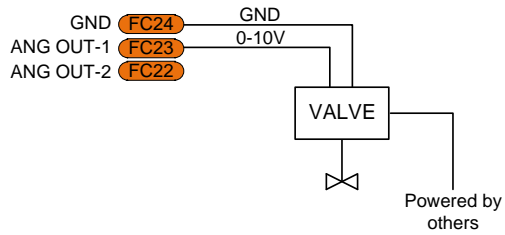

Heat/Cool Valve connection using ANG OUT-2

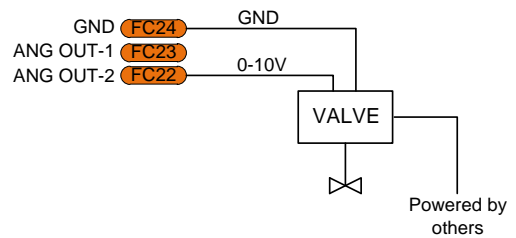

Remote Thermistor



## 6. Document Information

---

### Author

Jasmeet Talwar

### **INNCOM by Honeywell**

277 West Main Street

Niantic, CT 06357

(860) 739 4468

---

### File

#### Source:

T:\FTP\Eng\_Data\Hotels\FO\_100\_INNtool\Documents\Wiring  
Guides\INNtool\_E528\_12VDC\_Line\_Voltage\_Wiring\_Diagram.doc

#### Distribution:

T:\FTP\Eng\_Data\Hotels\FO\_100\_INNtool\Documents\Wiring Guides\INNtool\_E528\_S5\_Line\_Voltage\_Wiring\_Diagram.pdf

---

### Version

2017/12/05 Version 3.2